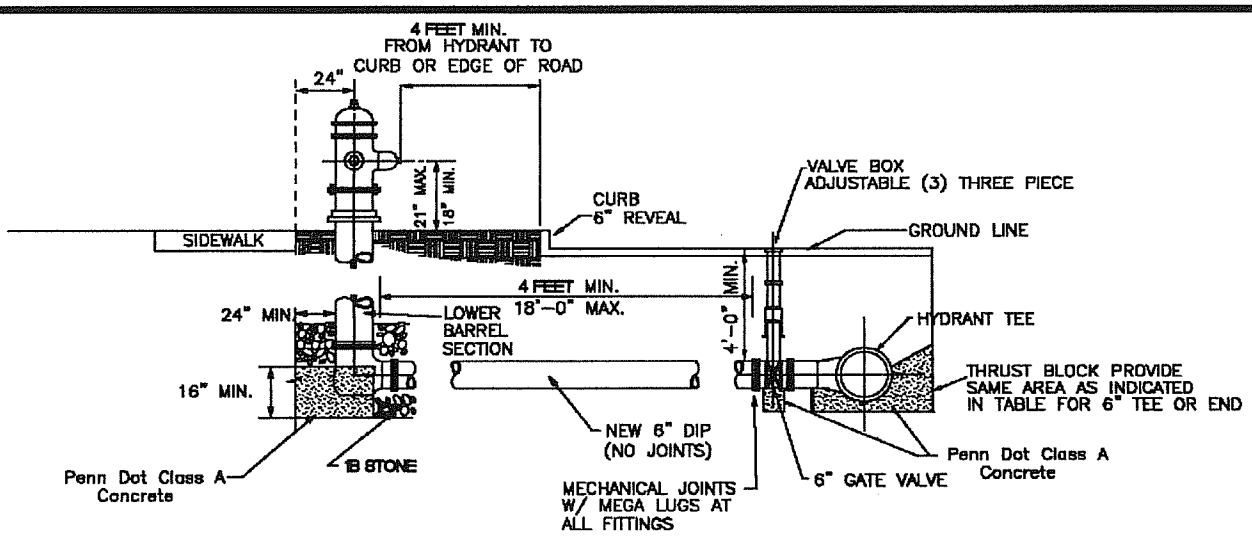

TYPICAL FIRE HYDRANT WITH CURBS

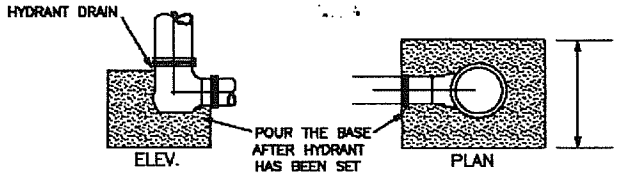

This type of hydrant foundation acts as a thrust-block, as an anchorage against frost-heave and eliminates washouts from waste-water drain.

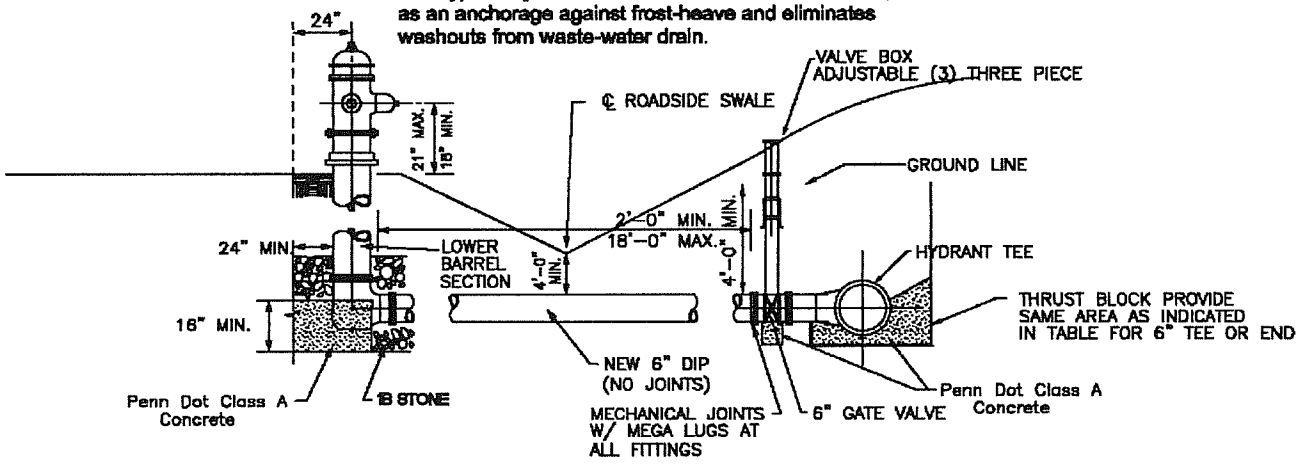

TYPICAL FIRE HYDRANT WITHOUT CURBS

NOTE:

1. The fire hydrant shall be "American Darling" Fire Hydrant model B-62-B, 6" M.J. FLG Opens Left (CCW) with nozzle cap chains.
2. The fire hydrant shall be set plumb (NO EXCEPTIONS).
3. Note 12.06 and 12.13 of specifications.
4. The tee (tapping saddle), valve and hydrant shall be supported by concrete cradle, not blocked.
5. Hydrants shall be set plumb at designed burial depth and braced firmly during installation while concrete cradles are poured and cured.
6. Piping, valves and hydrant parts coming in contact with concrete shall be polywrapped with 8mil plastic.
7. Weep holes shall not be blocked by polywrap or concrete.
8. Valve and hydrant shall be wrapped with polywrap where they contact concrete.

STANDARD DETAIL
TYPICAL FIRE HYDRANT DETAILS
WASHINGTON TOWNSHIP
MUNICIPAL AUTHORITY

DATE	REVISIONS

SCALE	DWG
NO SCALE	FH- 1

C:\WTMA DETAILS\FIRE PROTECTION\dwg\DETAILS.dwg, 8/25/2009 12:49:43 PM, Adobe PDF