


W	D
WATER MAIN	48" MIN.
WHC	48" MIN.

TYPICAL SECTION
(SEPARATE TRENCH)

L	H
10'-0" & GREATER	N/A
LESS THAN 10'-0"	18" MIN.

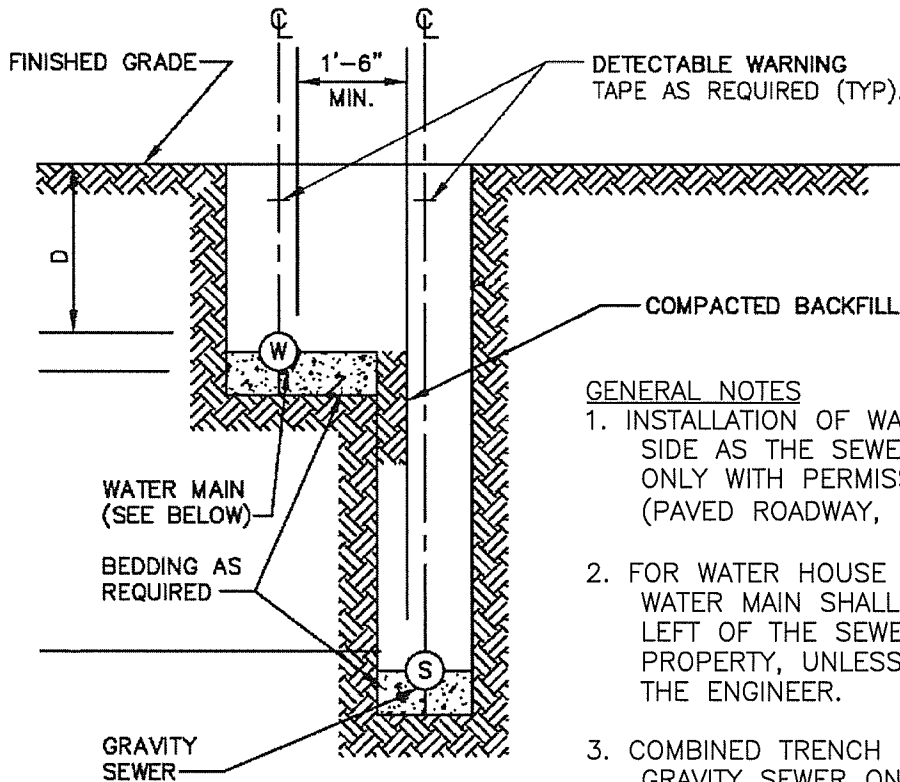

GENERAL NOTES

1. INSTALLATION OF WATER PIPE ON THE SAME SIDE AS THE SEWER TRENCH IS ALLOWED ONLY WITH PERMISSION OF THE ENGINEER (PAVED ROADWAY, ETC.).
2. FOR WATER HOUSE CONNECTIONS (WHC), THE WATER MAIN SHALL BE INSTALLED TO THE LEFT OF THE SEWER MAIN LOOKING AT THE PROPERTY, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
3. COMBINED TRENCH INSTALLATION IS FOR GRAVITY SEWER ONLY.

OPTIONAL SECTION
(COMBINED TRENCH)

STANDARD DETAIL
MINIMUM CLEARANCE
OF WATER PARALLEL
TO SEWER
WASHINGTON TOWNSHIP MUNICIPAL AUTHORITY

DATE	REVISIONS
SCALE NO SCALE	DWG. NO. P-10