


PLAN OF VAULT-TOP SLAB REMOVED

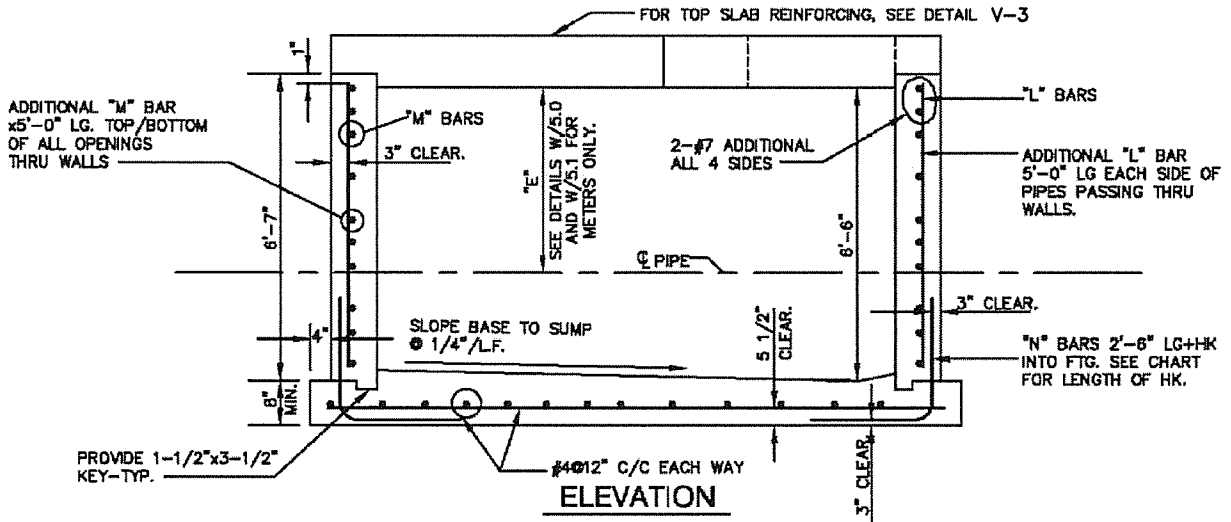

ELEVATION

"P"	"Q"	"R"	"L"	"M"	"N"
8"	6'-0"	6'-0"	#4@12"	#4@12"	#5@12"+2'-0" HK
8"	6'-0"	8'-0"	#4@12"	#4@12"	#5@12"+3'-0" HK
8"	6'-0"	10'-0"	#4@10"	#4@12"	#5@12"+3'-0" HK
8"	8'-0"	8'-0"	#4@10"	#4@12"	#5@10"+3'-0" HK
8"	8'-0"	10'-0"	#4@8"	#4@12"	#5@8"+3'-0" HK
8"	8'-0"	12'-0"	#4@6"	#4@12"	#5@6"+4'-0" HK

NOTES:
 1. SEE DETAILS V-8 AND V-9 FOR VAULT SIZE AND METER INSTALLATION DETAILS

STANDARD DETAIL CAST IN PLACE CONCRETE VAULTS FOR METERS AND VALVES WASHINGTON TOWNSHIP MUNICIPAL AUTHORITY	DATE	REVISIONS
SCALE NO SCALE		DWG. NO. V-6