
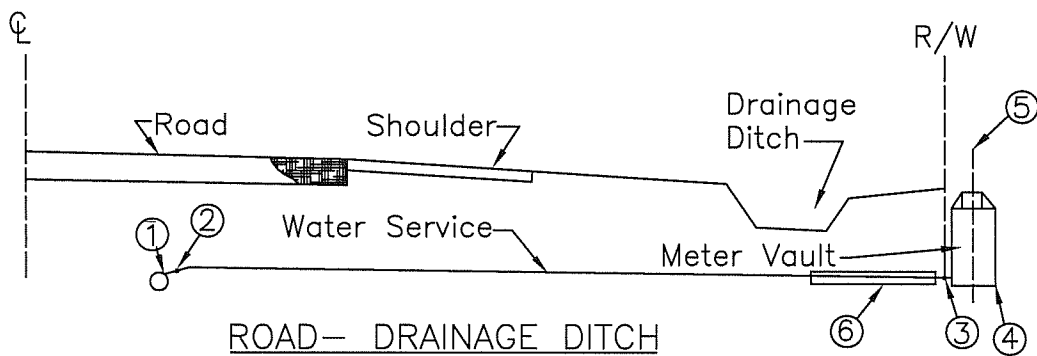


NOTES:

1. Tap on water main to be made at the 1 o'clock position.
2. Corporation stop.
3. Curb stop to be placed on Right-of-Way line.
4. Curb stop to be within 2' of meter vault.
5. Center line of meter vault to be 1'-6" from right of way line.
6. When water service is crossed by drainage swells the service lateral shall be bedded in clean clay. The intent is to prevent ground water from following the bedding.

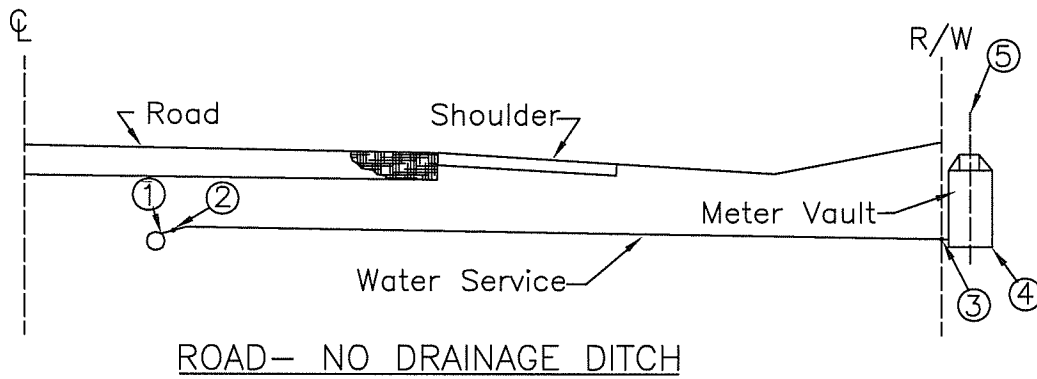

STANDARD WATER DETAILS

WATER METER LOCATION

WASHINGTON TOWNSHIP MUNICIPAL AUTHORITY

DATE	REVISIONS
SCALE NO SCALE	DWG. NO. W-1